




**CONCRETE CRADLE  
RIGID PIPE**

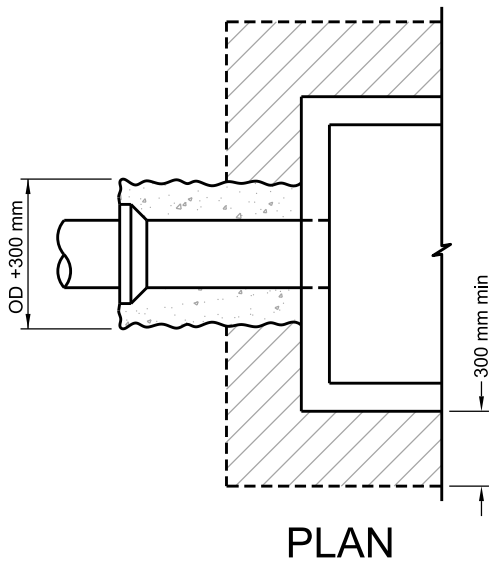

**FLEXIBLE JOINT  
RIGID AND FLEXIBLE PIPE**

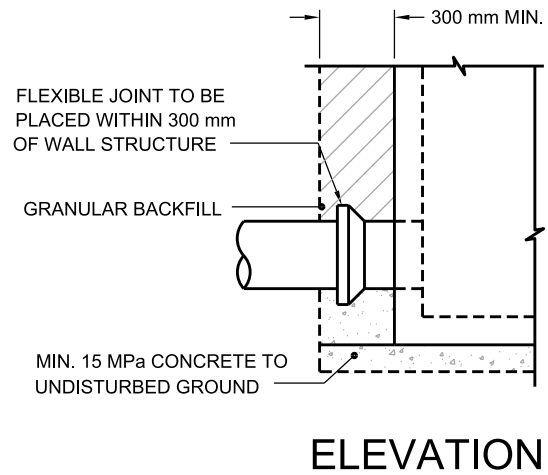

**ELEVATION**

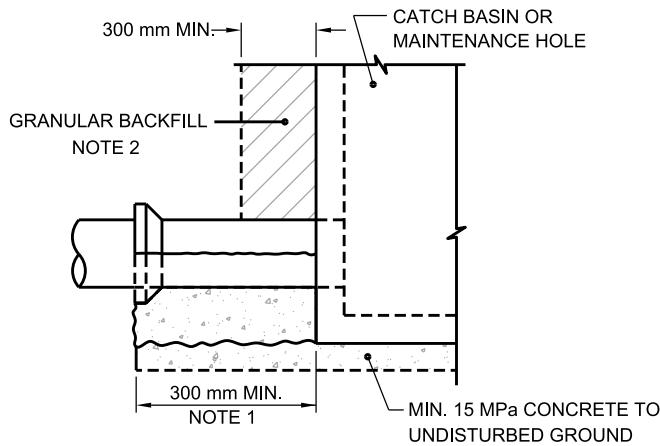

**ELEVATION**

**FLEXIBLE, WATERTIGHT CONNECTOR  
RIGID AND FLEXIBLE PIPE**

FOR INSTALLATION OF THESE CONNECTORS  
REFER TO MANUFACTURER'S INSTRUCTIONS.

A FULL LENGTH OF PIPE MAY BE USED  
IN CONJUNCTION WITH A FLEXIBLE,  
WATERTIGHT CONNECTOR.

**NOTES:**

1. PIPE TO BE SUPPORTED WITH MINIMUM 15 MPa CONCRETE TO THE FIRST PIPE JOINT.
2. GRANULAR BACKFILL AROUND PIPE CAN BE SUBSTITUTED WITH CONCRETE COLLAR, IF REQUIRED BY ENGINEER.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

REV 2

APR 2013

**CONNECTION DETAIL FOR PIPE  
AT CATCH BASIN OR MAINTENANCE HOLE**

T-708-020

NTS

SHEET 1