


PLAN

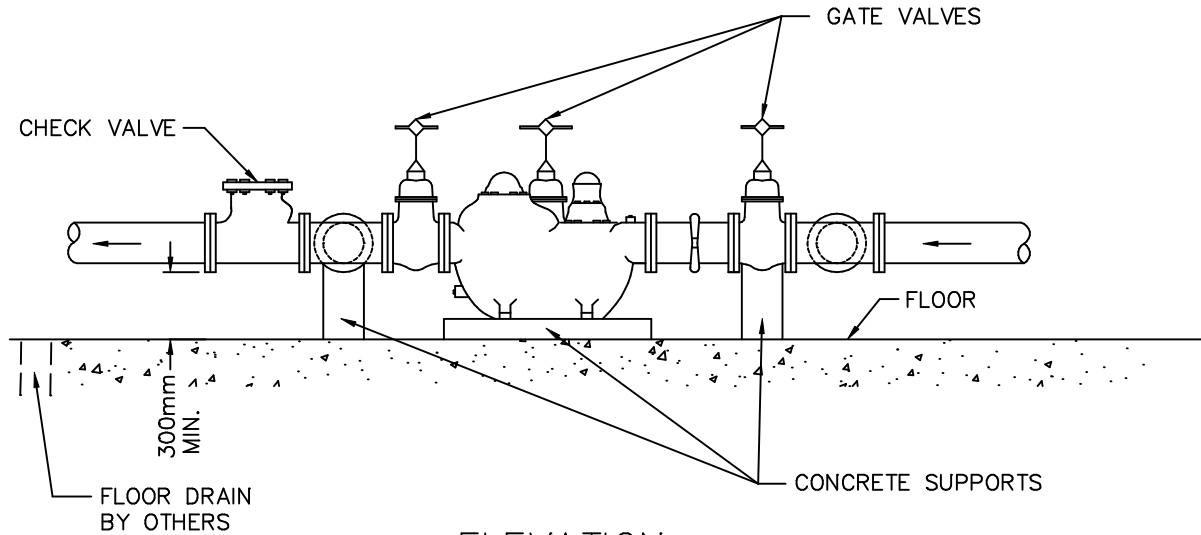

ELEVATION

NOTES

1. CONCRETE TO BE 20MPa COMPRESSIVE STRENGTH.
2. MINIMUM 900mm CLEARANCE FROM  $\phi$  OF METER TO NEAREST WALL AND 300mm CLEARANCE FROM OUTSIDE OF BY-PASS TO NEAREST WALL.
3. BY-PASS LINE SIZE TO BE SAME AS METER LINE.
4. BY-PASS VALVES TO BE CLOSED AND SEALED BY THE CITY.
5. THE METER INSTALLATION SHALL CONFORM TO THE MANUFACTURER'S REQUIREMENTS.

**METRIC**  
ALL DIMENSIONS SHOWN HERE ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

APPROVED BY

*Tom Denes*  
TOM DENES, P. ENG.  
EXECUTIVE DIRECTOR TECHNICAL SERVICES

SCALE

N.T.S.

DATE: JUNE, 2001

REVISED:

STANDARD No.

T-1107.02-1



PIPING LAYOUT FOR WATER METERS  
75 to 250mm IN CHAMBERS