


CROSS SECTION

SECTION A


15 MPa CONCRETE ENCASEMENT 50 mm AT BELL AND 100 mm AT BARREL

50 mm x 200 mm PLANKS



DRAIN

CONCRETE ENCASED WHERE REQUIRED

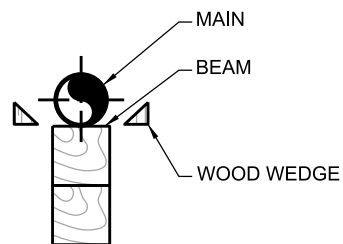

SERVICES AND MAINS

SIZE OF PIPE SUPPORTED	(A) UPRIGHT	(B) BEAM	(C) SILL
38, 50 & 75	100 x 100	1/50 x 150	50 x 200 x 600
100 & 125	150 x 150	2/150 x 150	50 x 200 x 600
150 & 200	200 x 200	2/200 x 200	50 x 200 x 600
250 & 300	300 x 300	2/300 x 300	50 x 200 x 600

NOTES:

1. WHERE THE WIDTH OF TRENCH EXCEEDS 2m METHOD OF CONSTRUCTION IS TO BE SPECIFIED BY THE SUPERVISING ENGINEER.
2. THE CONTRACTOR IS REQUIRED TO MAINTAIN ALL SERVICES AND MAINS ENCOUNTERED DURING CONSTRUCTION AND SUPPORT THEM AFTER CONSTRUCTION OF THE PIPE.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

TYPICAL DETAILS FOR SUPPORTING SERVICES AND MAINS UP TO 300 mm

REV 1

APR 2013

T-1007.01

NTS

SHEET 1