


ANGLE POLE ATTACHMENT
Line Angle Greater Than 30 degrees

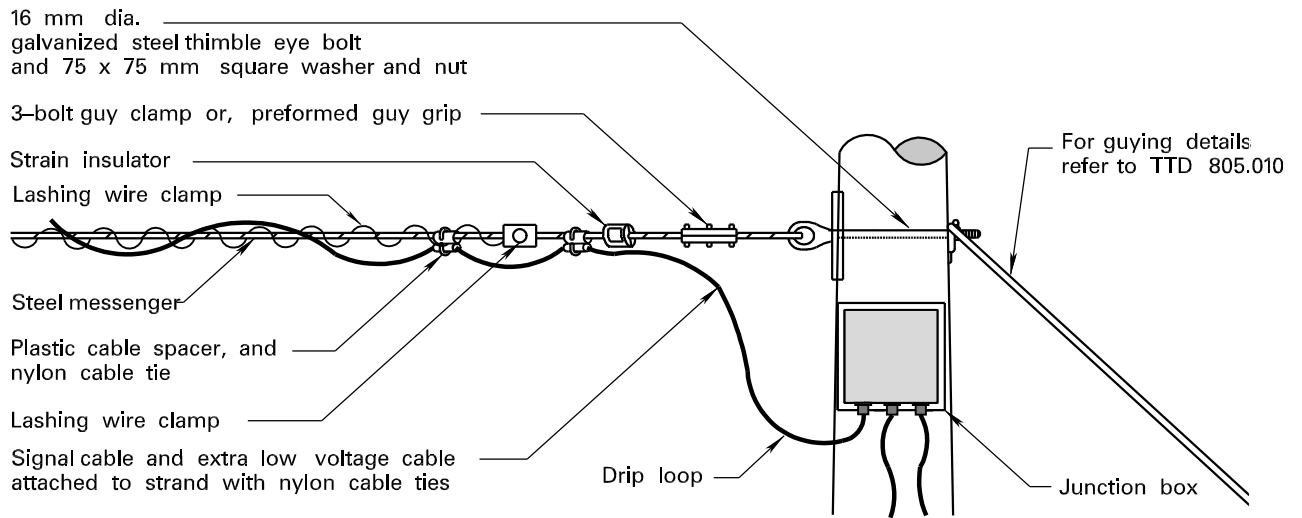

DEAD END ATTACHMENT

NOTES

1. For number and type of cable, refer to layout drawing and wiring diagrams. For cable arrangement, riser conduit and junction box requirements, refer to TTD 804.025, TTD 804.030, layout or detail drawings.
2. Pole attachment height shall be at 600 mm minimum from pole top, and as high as possible. For minimum attachment heights see TTD 804.035
3. For non-permanent installations of 70 m spans or shorter, nylon cable ties at 450 mm o/c may be used in lieu of lashing wire for cable support.

Dimensions are in millimetres or metres, unless otherwise shown.