
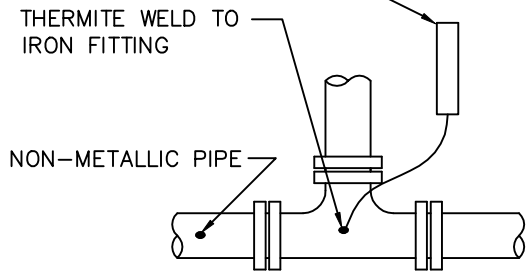


SERVICE CONNECTIONS

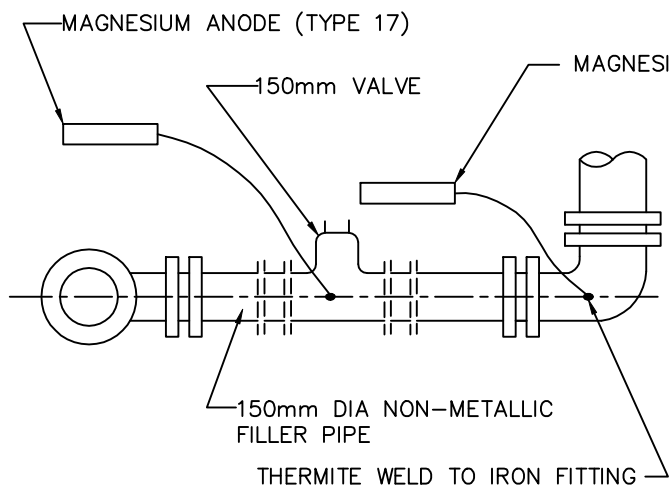

IRON TEES, WYES, CROSSES, BENDS, REDUCERS, SLEEVES & VALVES NOT IN CHAMBERS

HYDRANT INSTALLATION

NOTES:

1. CATHODIC PROTECTION NOT REQUIRED ON FITTINGS CONNECTED TO METALLIC MAIN
2. ALL EXPOSED THERMITE WELDS MUST BE PROTECTED WITH A THICK COATING OF T.C. MASTIC OR HANDI-CAP.

METRIC
ALL DIMENSIONS SHOWN HERE ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

APPROVED BY *[Signature]*
TOM DENES, P. ENG.
EXECUTIVE DIRECTOR TECHNICAL SERVICES

SCALE N.T.S.

DATE: JUNE, 2001

REVISED:

STANDARD No.

T-1106.04



CATHODIC PROTECTION FOR VALVES NOT IN CHAMBER
IRON FITTINGS, HYDRANT & SERVICE CONNECTION
ON NON-METALLIC MAINS