
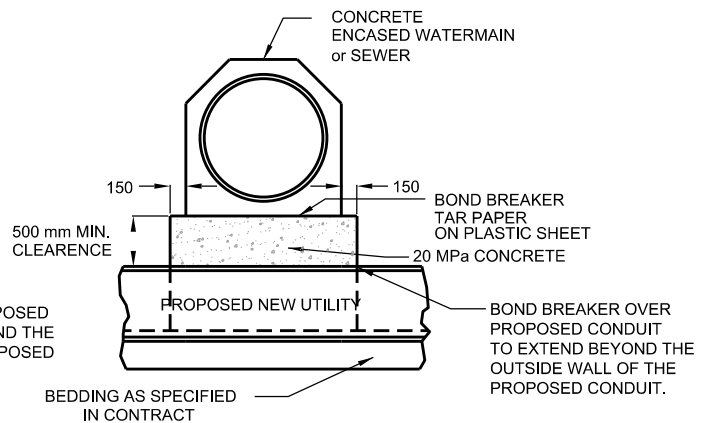


SECTION B

NOTES:

1. CONCRETE ENCASED STEEL MAINS SHALL BE SUPPORTED WITH CONCRETE TO THE UNDERSIDE OF MAIN. TAR PAPER IS TO BE USED BETWEEN THE TWO CONCRETE SURFACES.
2. WATERMAINS SHALL HAVE A BEARING BLOCK OR PLATE OF MIN. DIMENSION OF 75 mm x 200 mm WEDGES BETWEEN THE PIPE OR CONDUIT AND THE CONCRETE SUPPORT.
3. WHERE THE PROPOSED NEW UTILITY IS A PVC OR HDPE PIPE, AN ADDITIONAL RIGID BOARD COMPRESSIBLE BOND BREAKER OF SUFFICIENT STRENGTH AND THICKNESS SHALL BE PLACED OVER THE NEW CONDUIT AND SURROUNDING BEDDING TO ENSURE NO LOAD TRANSFER TO THE PROPOSED NEW CONDUIT.

SECTION A

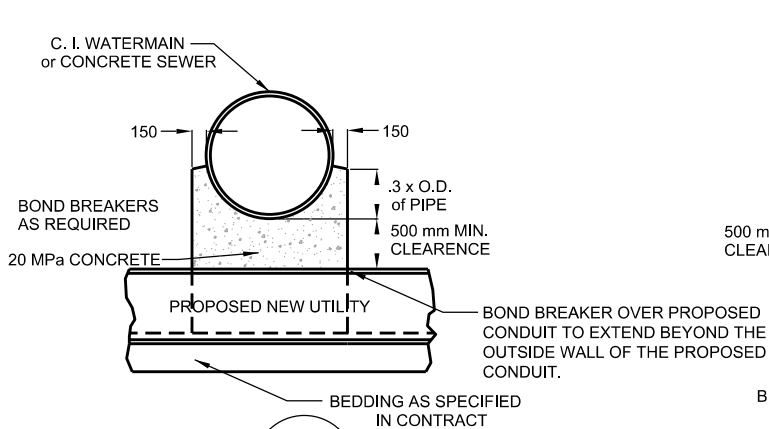

SECTION A

SECTION A

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

REV 2

APR 2014

TYPICAL DETAIL FOR SUPPORTING WATER AND SEWER PIPE
LARGER THAN 300 mm DIAMETER
OVER NEW WATERMAIN OR SEWER

T-1007.01-4

NTS

SHEET 1