



FLANGE END METER
40mm-UP




PLAN VIEW

SCREW END METER



PLAN VIEW

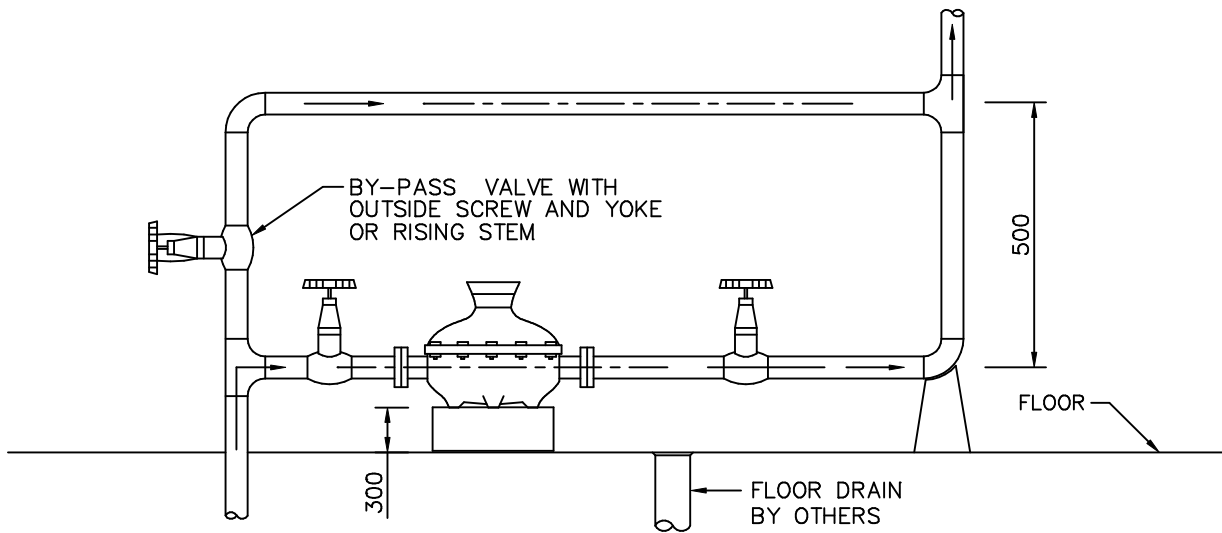

NOTES:

1. FEMALE ENDS MUST BE PROVIDED FOR ALL SCREW END METERS.
2. DOMESTIC WATER SERVICE AND BY-PASS TO BE EQUAL IN SIZE.
3. ALL CHECK VALVES, BACK FLOW PREVENTERS, PRESSURE REDUCING VALVES, MUST BE LOCATED BEYOND THE BY-PASS.
4. METERS 40mm AND LARGER TO HAVE REMOVABLE SUPPORTS.
5. BY-PASS VALVE TO BE CLOSED AND SEALED BY THE CITY.
6. THE METER INSTALLATION SHALL CONFORM TO THE MANUFACTURER'S REQUIREMENTS.

 METRIC
ALL DIMENSIONS SHOWN HERE ARE IN
MILLIMETRES UNLESS OTHERWISE NOTED

APPROVED BY


TOM DENES, P. ENG.
EXECUTIVE DIRECTOR TECHNICAL SERVICES

SCALE

N.T.S.

DATE: JUNE, 2001

REVISED:

STANDARD No.

T-1107.04-1