




PLAN  
( NO BY-PASS )

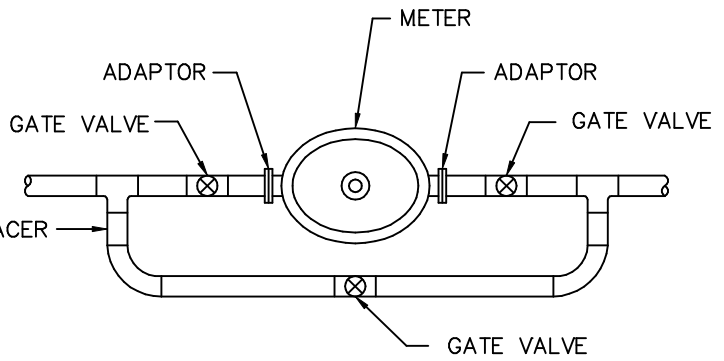

PLAN  
( WITH BY-PASS )

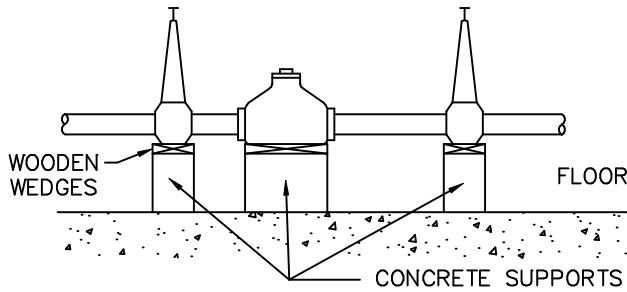

ELEVATION

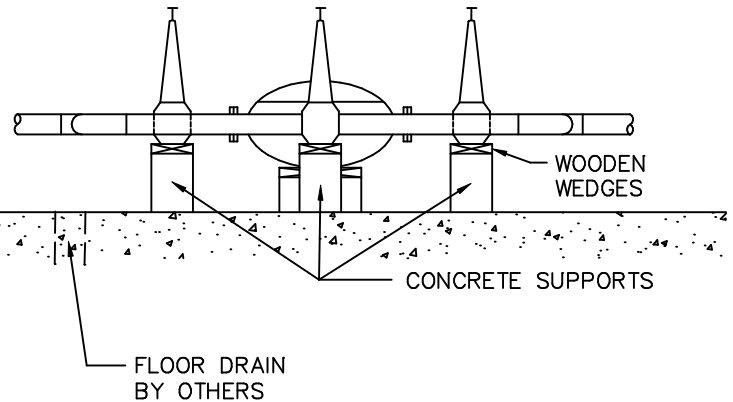

ELEVATION

NOTES

1. CONCRETE TO BE 20MPa COMPRESSIVE STRENGTH.
2. MINIMUM 900mm CLEARANCE FROM  $\phi$  OF METER TO NEAREST WALL AND 300mm CLEARANCE FROM OUTSIDE OF BY-PASS TO NEAREST WALL.
3. BY-PASS LINE SIZE TO BE SAME AS METER LINE.
4. BY-PASS VALVES TO BE CLOSED AND SEALED BY THE CITY.
5. THE METER INSTALLATION SHALL CONFORM TO THE MANUFACTURER'S REQUIREMENTS.

 METRIC  
ALL DIMENSIONS SHOWN HERE ARE IN  
MILLIMETRES UNLESS OTHERWISE NOTED

APPROVED BY

  
TOM DENES, P. ENG.  
EXECUTIVE DIRECTOR TECHNICAL SERVICES

SCALE

N.T.S.

DATE: JUNE, 2001

REVISED:

STANDARD No.

T-1107.01-1