



PLAN OF REINFORCED CONCRETE SLAB

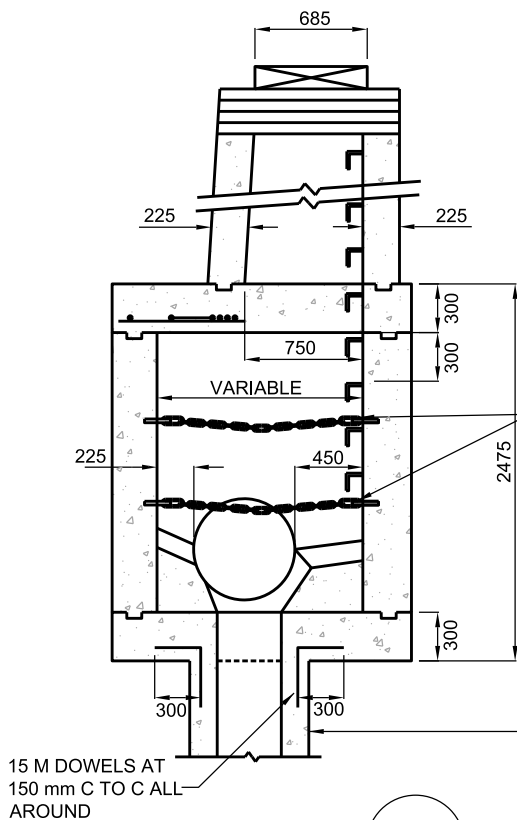

SECTION A

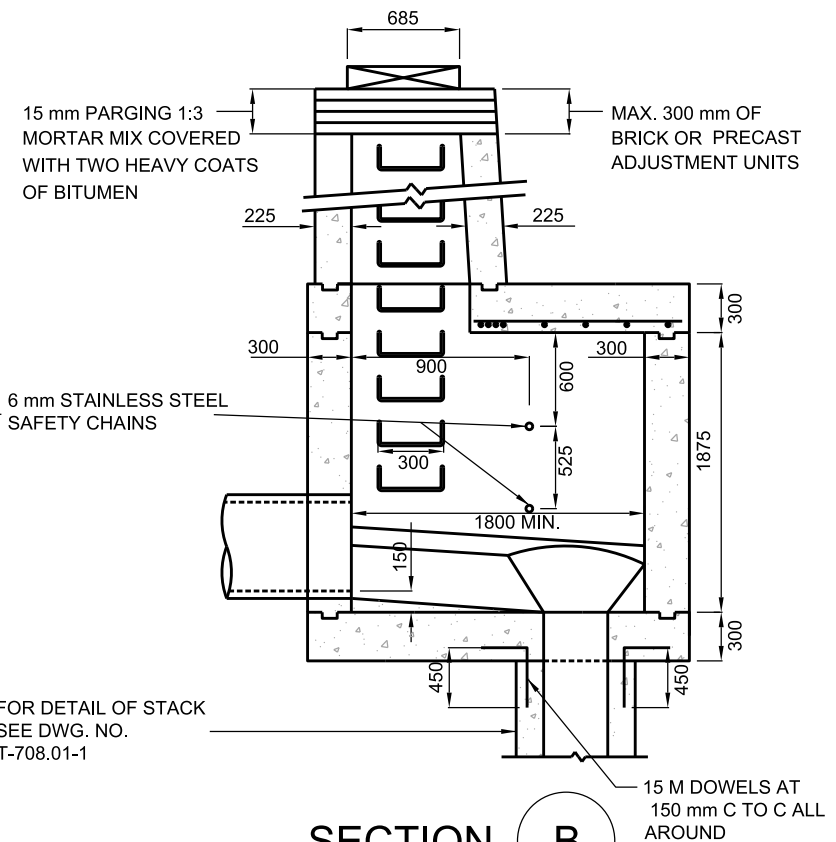

SECTION B

NOTES:

1. CONCRETE AT 28 DAYS SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 32 MPa.
2. REINFORCING STEEL BARS SHALL BE C.S.A. STANDARD G30.12 OR G30.13.
3. CONCRETE COVER ON REINFORCING STEEL IN ROOF SLAB SHALL BE 50 mm.
4. FIRST STEP TO BE 75 mm TO 300 mm BELOW FRAME. LAST STEP TO BE 300 mm ABOVE BENCHING OR 600 mm ABOVE INVERT IF NO BENCHING.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

REV 1

APR 2013

CONCRETE MAINTENANCE HOLE
OVER STACK

T-701.015-1

NTS

SHEET 1