

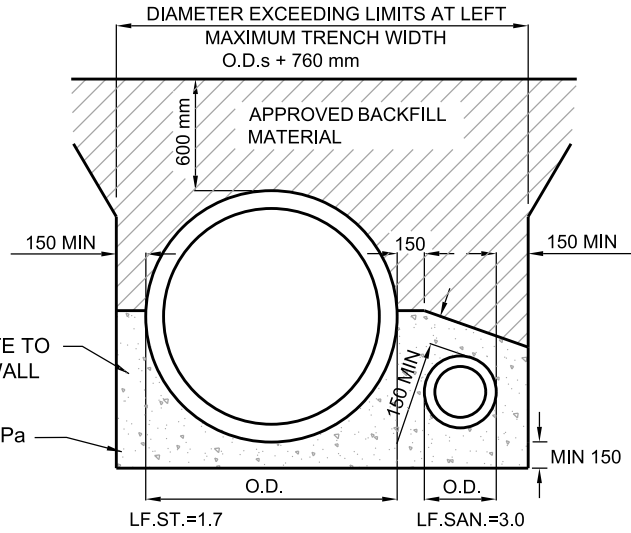


LIMITS: 250 Ø & 300 Ø TO 250 Ø & 750 Ø
 300 Ø & 375 Ø TO 300 Ø & 825 Ø
 375 Ø & 450 Ø TO 375 Ø & 900 Ø

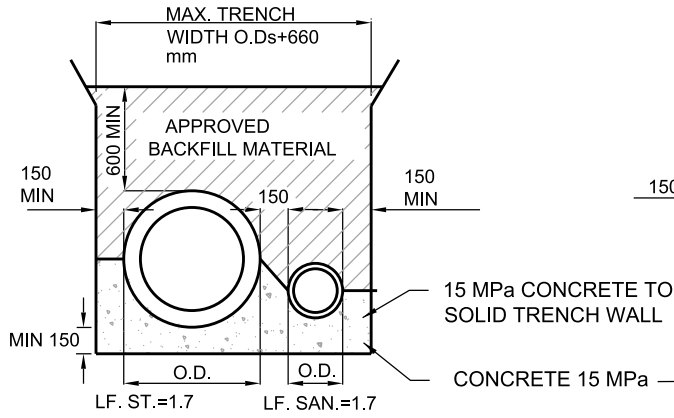


BEDDING TYPE D1


THE APPROVED BACKFILL TO BE COMPACTED IN 150 mm LAYERS TO 95% STANDARD PROCTOR DENSITY.

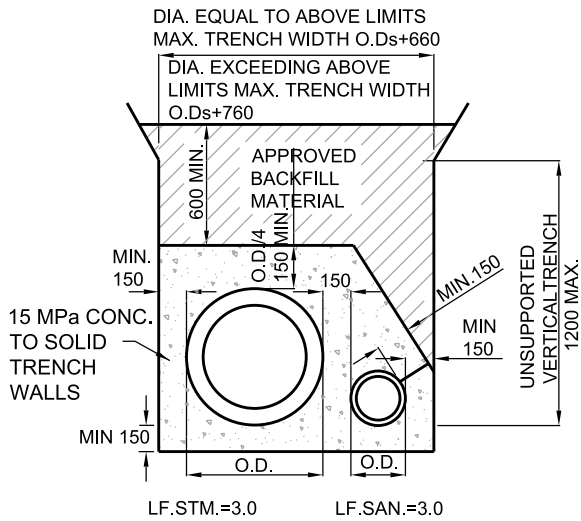

BEDDING TYPE D2

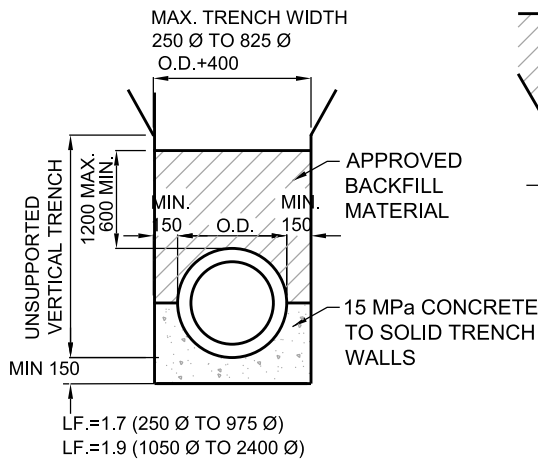

BEDDING TYPE S1

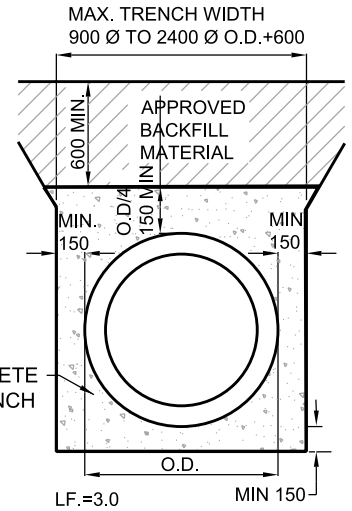

BEDDING TYPE S2

DIA.	O.D./4	DIA.	O.D./4	DIA.	O.D./4
250	* 150	750	235	1500	460
300	* 150	825	260	1650	500
375	* 150	900	280	1800	545
450	150	975	300	1950	600
525	165	1050	330	2100	635
600	190	1200	370	2250	685
675	215	1350	410	2400	720

* MINIMUM CONCRETE BEDDING COVER FOR TYPE TWO (2) TO BE 150 mm

NOTES:

- FOR BEDDING TYPE D1 AND S1, CONCRETE BELOW PIPE SHALL BE OUTSIDE DIAMETER DIVIDED BY 4 AND 100 mm MIN. AND 300 mm MAX.
- FOR BEDDING TYPE D2 AND S2, CONCRETE BELOW PIPE SHALL BE 150 mm FOR PIPE DIAMETER UP TO 900 mm AND 200 mm FOR PIPE DIAMETERS LARGER THAN 900 mm

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

CONCRETE BEDDING DETAILS FOR CONCRETE PIPES

REV 2

APR 2013

T-802.032-1

NTS

SHEET 1