




CROSS SECTION

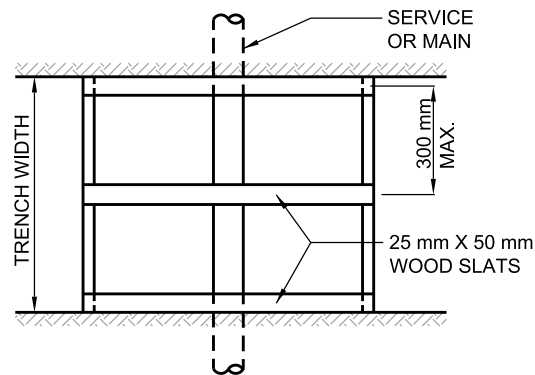

PLAN VIEW

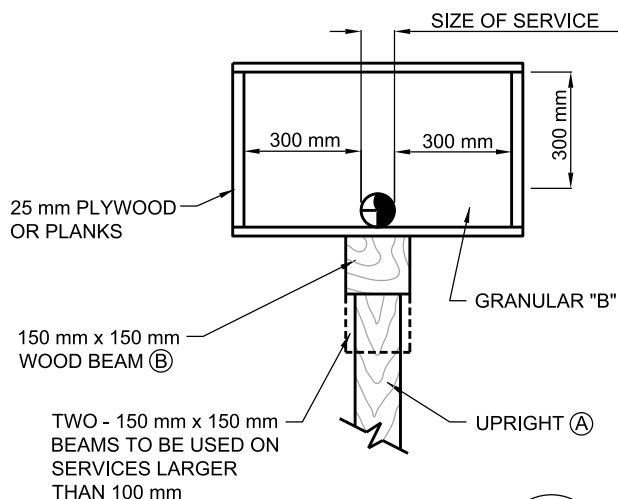

SECTION A

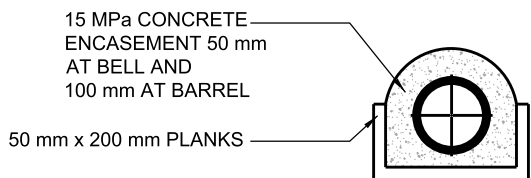

DRAIN

CONCRETE ENCASED WHERE REQUIRED

SIZE OF PIPE SUPPORTED	(A) UPRIGHT	(B) BEAM	(C) SILL
38, 50 & 75	100 x 100	1/150 x 150	50 x 200 x 600
100 & 125	150 x 150	2/150 x 150	50 x 200 x 600
150 & 200	200 x 200	2/200 x 200	50 x 200 x 600
250 & 300	300 x 300	2/300 x 300	50 x 200 x 600

NOTES:

1. WHERE THE WIDTH OF TRENCH EXCEEDS 2 m, METHOD OF CONSTRUCTION IS TO BE SPECIFIED BY THE SUPERVISING ENGINEER.
2. THE CONTRACTOR IS REQUIRED TO MAINTAIN ALL SERVICES AND MAINS ENCOUNTERED DURING CONSTRUCTION AND SUPPORT THEM WHEN PIPE CONSTRUCTION HAS BEEN COMPLETED.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

TYPICAL DETAILS FOR SUPPORTING SERVICES AND MAINS UP TO 300 mm ENCOUNTERED IN TRENCHES BACKFILLED WITH UNSHRINKABLE FILL

REV 1

APR 2013

T-1007.01-1

NTS

SHEET 1