



PLAN

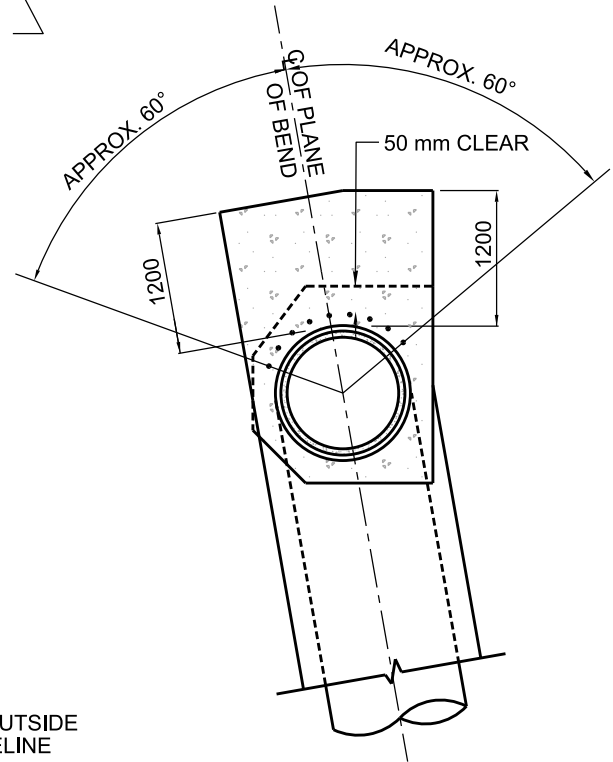

SECTION



NOTES:

1. REINFORCING RODS TO BE PLACED LONGITUDINALLY AROUND OUTSIDE OF BEND AND EXTENDED TO APPROX. 60° EACH SIDE OF CENTRELINE OF PLANE OF BEND FOR ALL BENDS 22° 30' AND OVER.
2. FOR BENDS 22° 30' AND UNDER 45° USE REINFORCING 10 M @ 100.
FOR BENDS 45° AND OVER USE REINFORCING 15 M @ 150.
3. FOR CONCRETE ENCASEMENT THICKNESS (T) REFER TO PLAN AND PROFILE.
WHERE $T < 150$ mm, $T1 = T + 50$ mm
WHERE $T > 150$ mm, $T1 = T$

All dimensions are in millimetres unless otherwise shown.

	ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING		REV 1	APR 2013	
	CONCRETE CASING FOR WELDED STEEL WATERMAIN PIPE FOR ALL ANGLES 22° 30' AND OVER			T-1103.020-4	
				NTS	SHEET 1