



MONOLITHIC CONCRETE CURB AND SIDEWALK

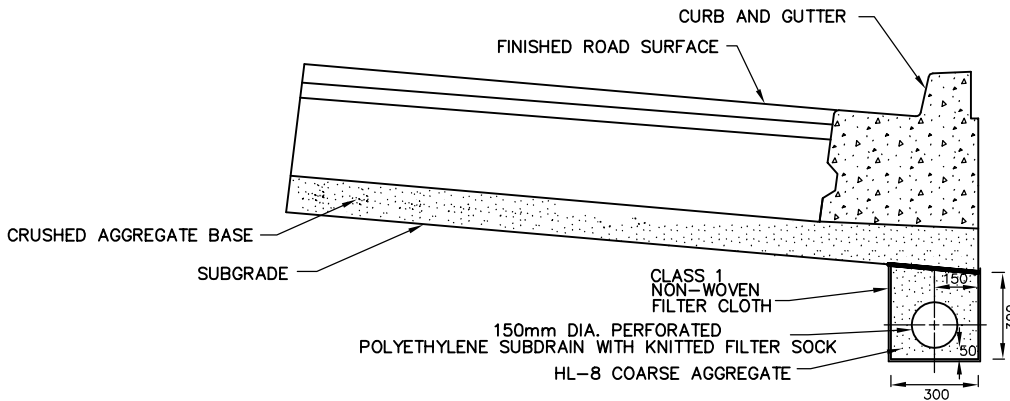

CONCRETE CURB AND GUTTER

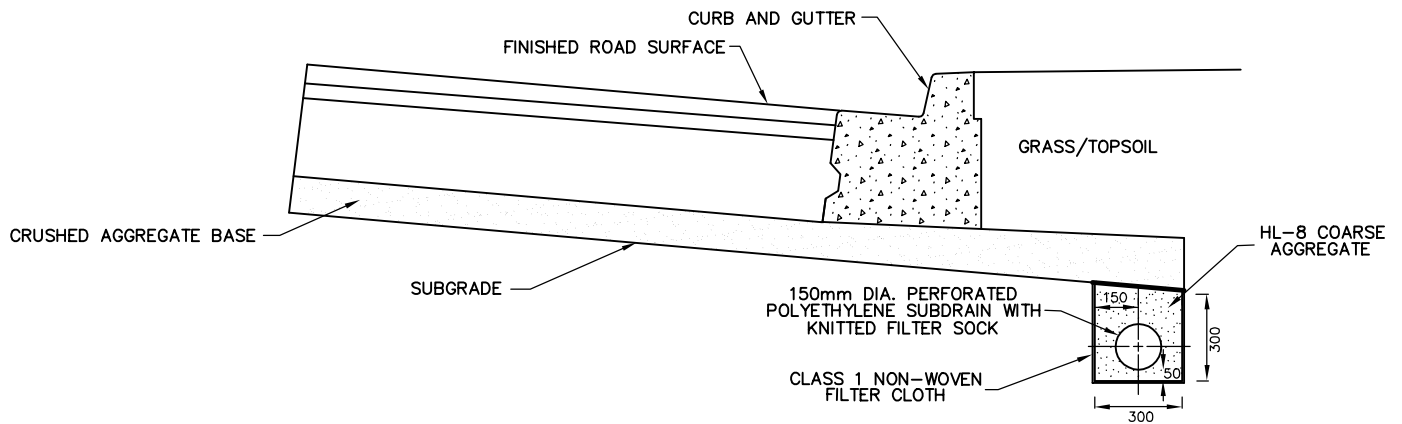

EXISTING CONCRETE CURB AND GUTTER WITH GRASS BOULEVARD

NOTES:

1. FILTER CLOTH SHALL BE OVERLAPPED 300mm IN ALL DIRECTIONS.
2. THE TOP OF COARSE AGGREGATE TO BE ABOVE THE BOTTOM OF ROAD SUB-GRADE
3. FOR NEW CURB CONSTRUCTION SUBDRAIN TO BE UNDER STONE BASE OF TH CURB, AS SHOWN ABOVE. FOR REHABILITATION WORK SUBDRAIN, INCLUDING 300X300 HLB COARSE AGGREGATE, TO BE PLACED AS DIRECTED BY OWNER.
4. IF THE EXISTING CONCRETE CURB AND GUTTER ARE TO REMAIN IN PLACE, THEN THE SUBDRAIN SHALL BE PLACED IN FRONT OF THE CURB AND GUTTER.

↑ METRIC
ALL DIMENSIONS SHOWN HERE ARE IN MILLIMETRES UNLESS OTHERWISE NOTED



WORKS & EMERGENCY SERVICES

TECHNICAL SERVICES DIVISION
Engineering Services - Works Facilities & Structures

ROADWAY SUBDRAINS

SCALE:

N.T.S.

DATE:

DECEMBER, 2004

DRAFTING:

V. DIDIANO

DRAWING NUMBER:

T-216.02-8

SHEET:

1