


PLAN

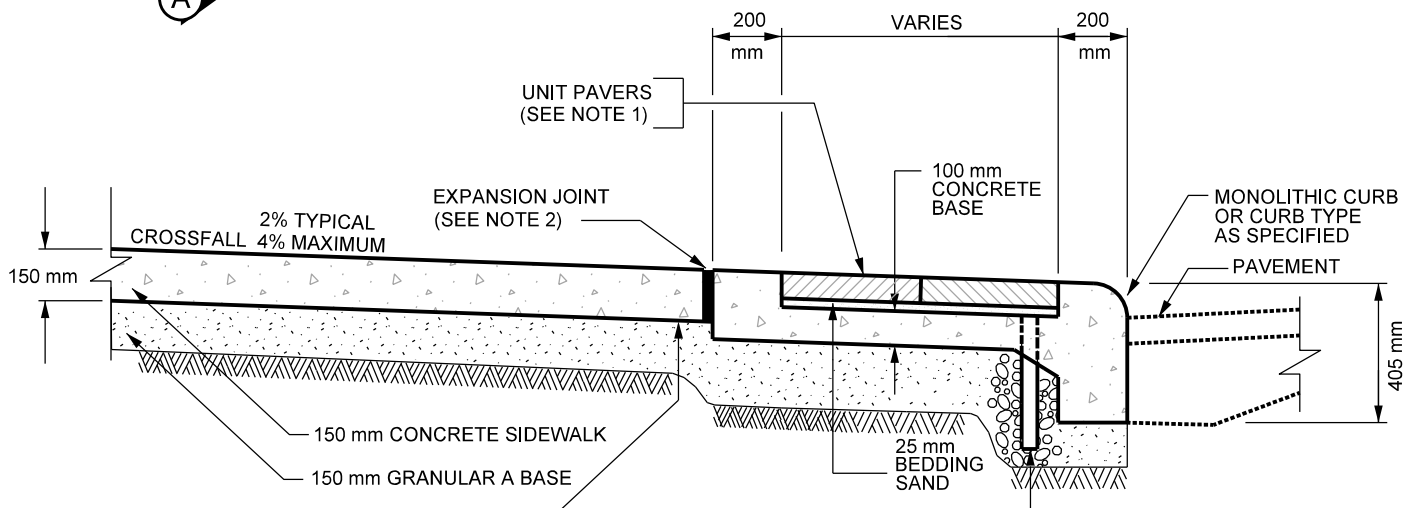

SECTION A - A

NOTES:

1. CONCRETE PAVER TYPE, SIZE, COLOUR, LAYING PATTERN AND CURB TYPE AS SPECIFIED.
2. WHEN SIDEWALK WIDTH IS LESS THAN 2.0 m REPLACE EXPANSION JOINT WITH TOOLED JOINT AND PLACE CURB, BASE AND WALK MONOLITHICALLY.

50 mm DIA. PLASTIC DRAIN PIPE  
 3 m O.C. 400 mm LONG WITH  
 19 mm TYPE II CLEAR STONE  
 WITH CLASS II NON-WOVEN NEEDLE  
 PUNCH GEOTEXTILE FABRIC  
 APPROX. 200 x 200 mm PLACED  
 OVER DRAIN PIPE

All dimensions are in millimetres unless otherwise shown.

	ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING		REV 5	SEP 2018	
	<p style="text-align: center;"><b>SIDEWALK PAVED WITH UNIT PAVER BAND AT CURB</b></p>			<b>T-310.020-2</b>	
				NTS	SHEET 1