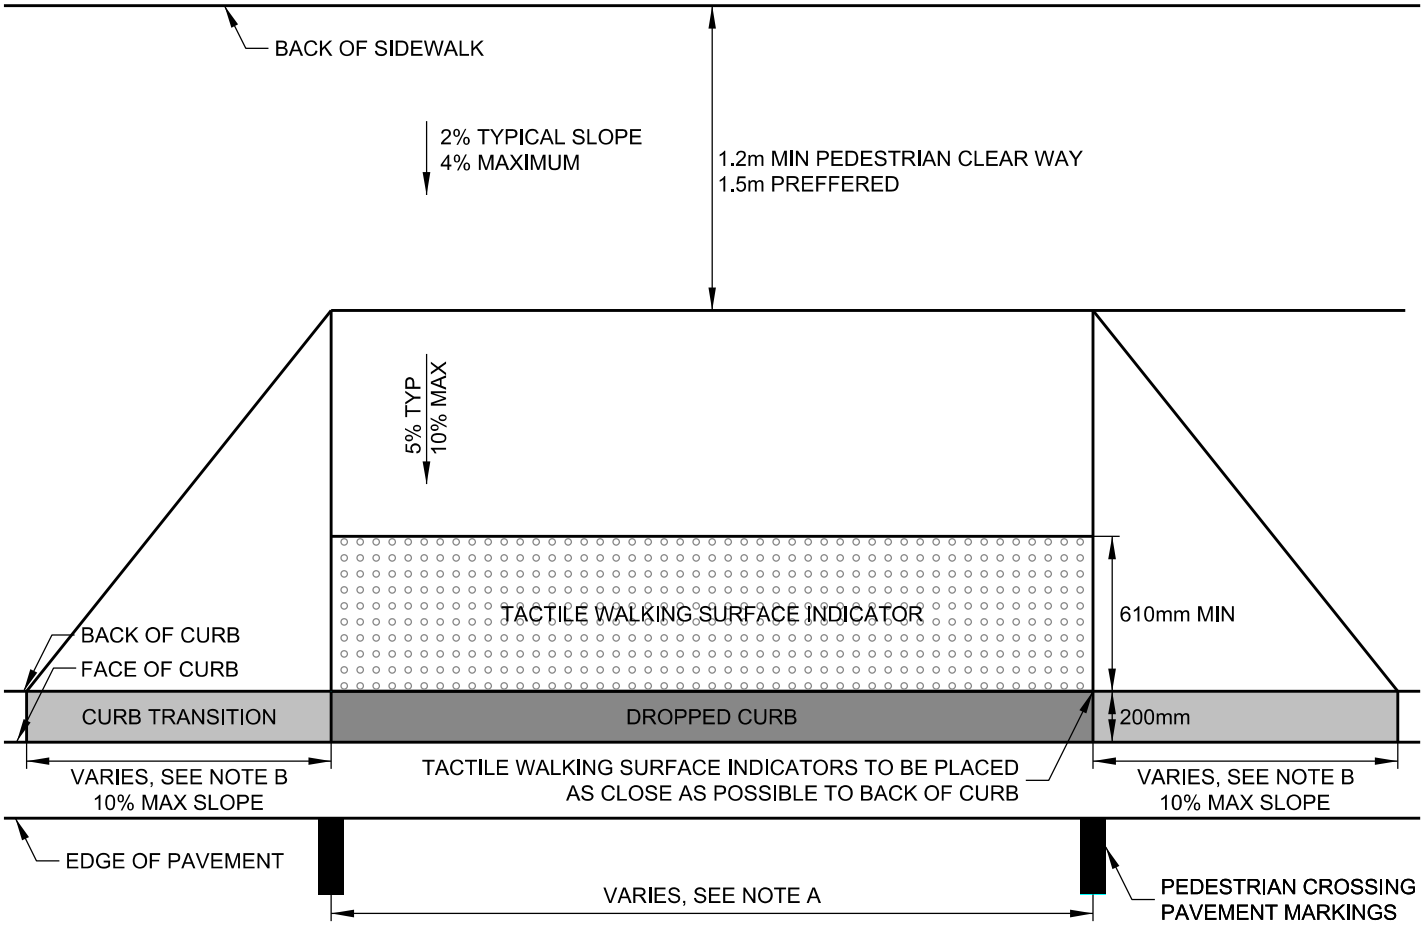

TACTILE WALKING SURFACE INDICATOR AND CURB RAMP

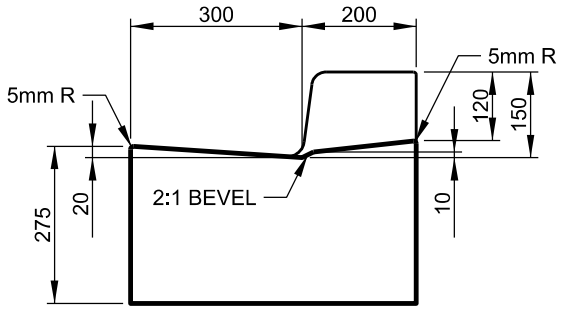

DROPPED CURB

NOTES:

A. 3.0m MINIMUM FOR SIGNALIZED INTERSECTIONS, 2.5m MINIMUM FOR NON SIGNALIZED INTERSECTIONS.

B. 1.2m MINIMUM FOR TRANSITIONS BETWEEN FULL HEIGHT CURB AND 120mm DROPPED CURB, 0.45m MINIMUM FOR TRANSITIONS BETWEEN 120mm DROPPED CURB AND 75mm DROPPED CURB.

1. REFER TO T-310.030-9 FOR INFORMATION ABOUT THE LOCATION OF DROPPED CURBS.

2. DEPRESSED CURBS (T-310.030-11) SHALL BE USED OVER CURB RAMPS WHENEVER POSSIBLE. CURB RAMPS SHOULD ONLY BE USED IN RESTRICTED SITE CONDITIONS WHERE DEPRESSED CURBS CANNOT BE ACCOMMODATED.

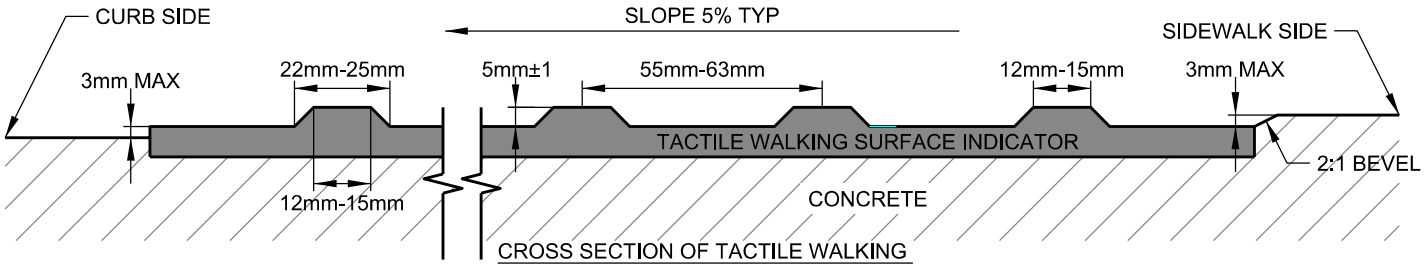

CROSS SECTION OF TACTILE WALKING SURFACE INDICATORS

All dimensions are in millimetres unless otherwise shown.

TORONTO	ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING	REV 2	SEP 2018
	TACTILE WALKING SURFACE INDICATOR AND CURB RAMP DETAIL	**T-310.030-10**	
		NTS	SHEET 1