




**CONCRETE CRADLE  
RIGID PIPE**

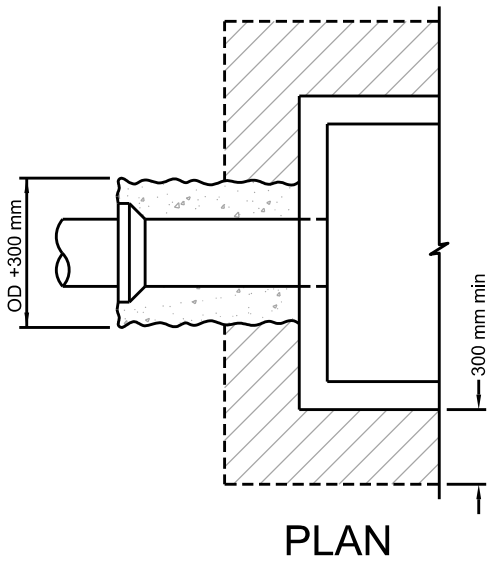

**FLEXIBLE JOINT  
RIGID AND FLEXIBLE PIPE**

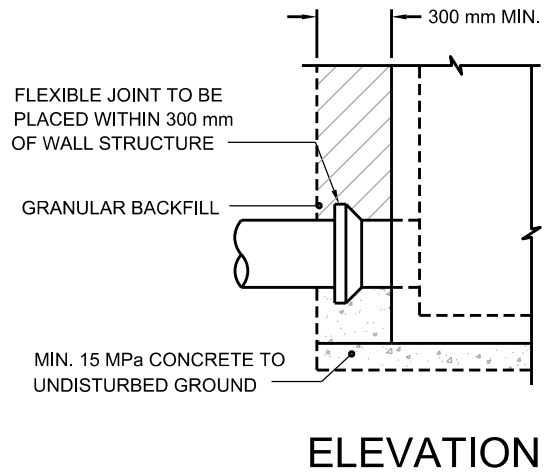

**ELEVATION**

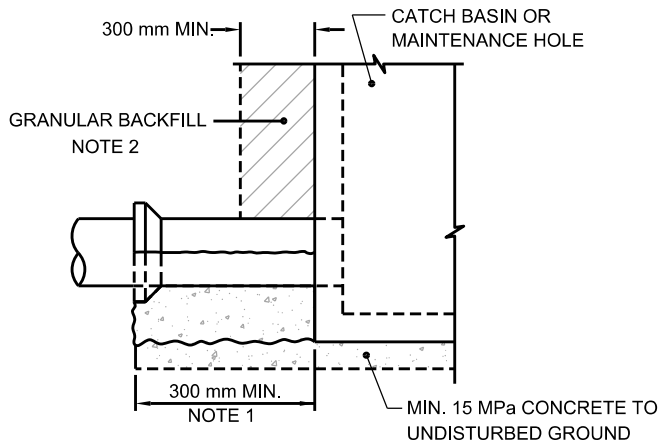

**ELEVATION**

**FLEXIBLE, WATERTIGHT CONNECTOR  
RIGID AND FLEXIBLE PIPE**

FOR INSTALLATION OF THESE CONNECTORS  
REFER TO MANUFACTURER'S INSTRUCTIONS.

A FULL LENGTH OF PIPE MAY BE USED  
IN CONJUNCTION WITH A FLEXIBLE,  
WATERTIGHT CONNECTOR.

**NOTES:**

1. PIPE TO BE SUPPORTED WITH MINIMUM 15 MPa CONCRETE TO THE FIRST PIPE JOINT.
2. GRANULAR BACKFILL AROUND PIPE CAN BE SUBSTITUTED WITH CONCRETE COLLAR, IF REQUIRED BY ENGINEER.
3. THESE CONNECTIONS ARE NOT PERMITTED AT A TRUNK SEWER MAINTENANCE HOLE.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING AND CONSTRUCTION SERVICES STANDARD DRAWING

REV 3

SEP 2019

**CONNECTION DETAIL FOR PIPE  
AT CATCH BASIN OR MAINTENANCE HOLE**

**T-708.020**

NTS

SHEET 1