


PLAN VIEW

NOTE :
 DEEP METER CHAMBER WITH STANDARD ROUND MANHOLE. CHAMBER SHAPE CAN BE SQUARE OR ROUND AND FINAL SIZE SHALL MEET OR EXCEED ANY SPACING REQUIREMENTS ACCORDING TO THE METER SIZE AND TORONTO WATER STANDARDS. THE DEEP CHAMBER SHALL INCLUDE PROVISION FOR TWO SHALLOW IRRIGATION BOX AT GRADE TO MEET PARKS OPERATION AND TECHNICAL STAFF STANDARDS TO ACCOMMODATE SEASONAL SHUT-DOWN AND TORONTO WATER METER TRANSMISSION UNIT (MTU)

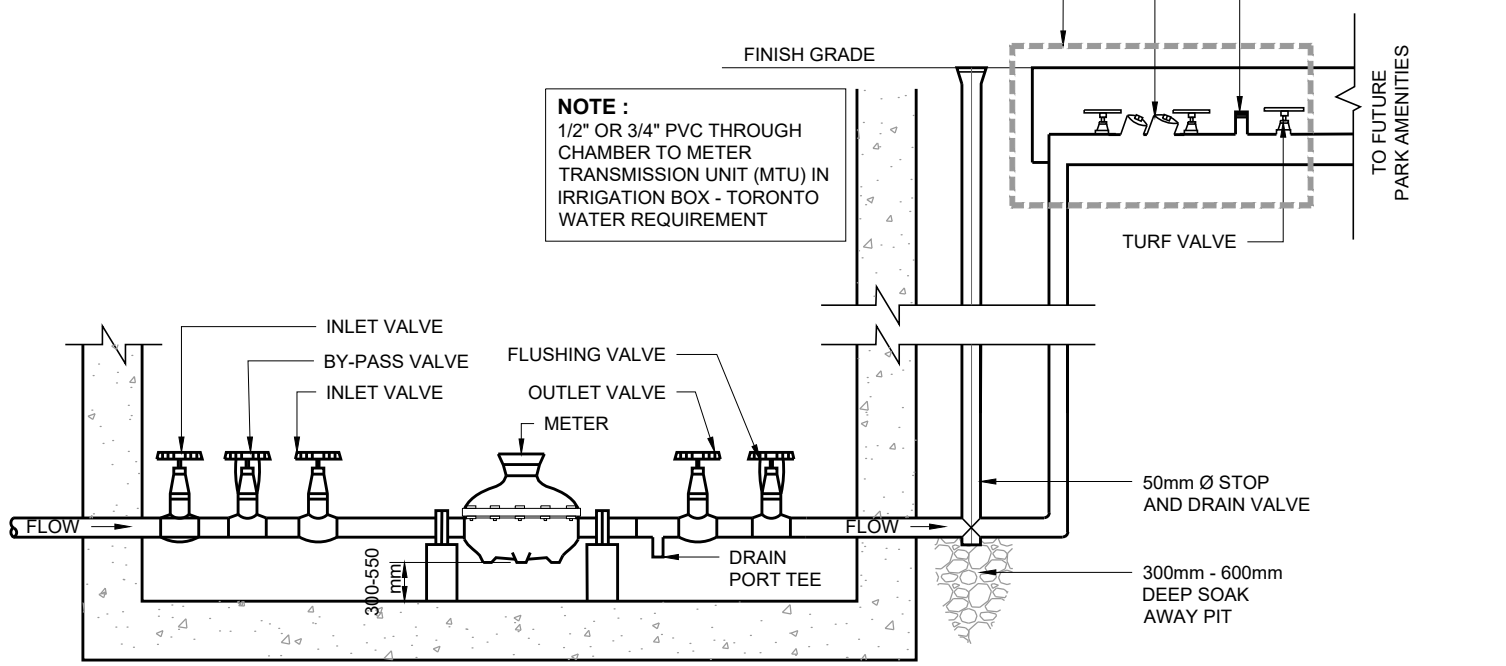

ELEVATION VIEW

NOTE :
 1/2" OR 3/4" PVC THROUGH CHAMBER TO METER TRANSMISSION UNIT (MTU) IN IRRIGATION BOX - TORONTO WATER REQUIREMENT



PARKS, FORESTRY & RECREATION STANDARD DRAWING

PIPING LAYOUT IN DEEP METER CHAMBER with 50 mm WATER SERVICE PIPE DETAIL

REV 0 MAR 2021

T-1130.020

NTS SHEET 1