




PLAN

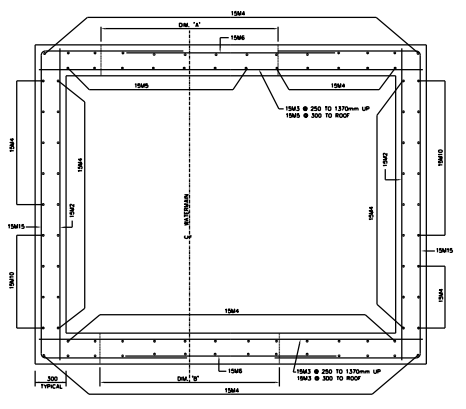


WALL SECTION

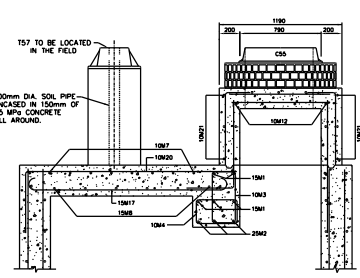


SECTION C-C

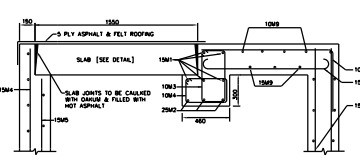


SECTION A-A




SPINDLE GUIDE BRACKET DETAIL




EXTENSION SPINDLE DETAIL




DETAIL 'A'




REINFORCING AROUND PIPE




SLAB DETAIL




REMOVABLE ALUMINUM LADDER




SECTION D-D



RUNG DETAIL

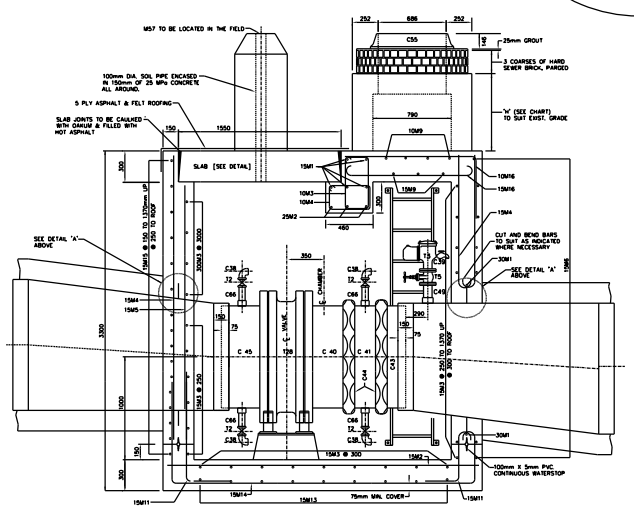

SECTION A-A

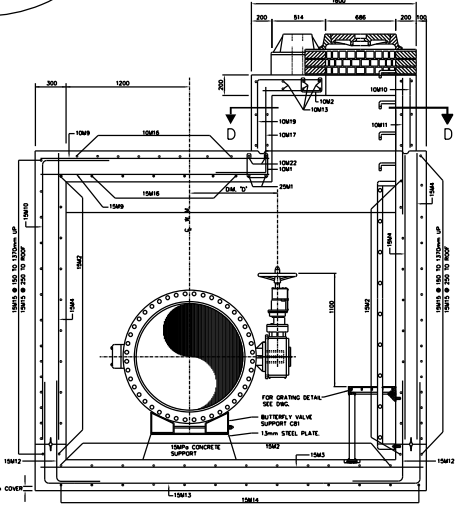

SECTION B-B

- NOTES:
- 25MPa CONCRETE TO BE USED EXCEPT AS NOTED.
 - MAXIMUM SIZE OF COARSE AGGREGATE TO BE 20mm
 - COVER TO MAIN REINFORCEMENT TO BE 50mm OR AS INDICATED.
 - ALL BAR DIMENSIONS ARE OUT TO OUT.
 - BAR TO BE BENT COLD, MINIMUM INSIDE RADIUS TO 4 DIAMETERS.
 - ALL CROSSING BARS TO BE WELL WELDED.
 - ALL REINFORCING STEEL TO BE REFORMED BILLET-STEEL BARS GRADE 350, CONFORMING TO C.S.A. STANDARD G30.12M
 - ALL LAPS IN REINFORCING STEEL TO BE AT LEAST 30 DIAMETERS IN LENGTH OR AS SHOWN, AND TO BE STAGGERED.
 - ALL BRICKWORK TO BE OF HIGH QUALITY HARD SEWER BRICK, LAID IN FULL MORTAR BED AND JOINTS, PARSED INSIDE AND OUT.
 - WATERSTOP (PVC) TO BE PROVIDED AT ALL CONSTRUCTION JOINTS.
 - WHERE NECESSARY ADJUST REINFORCING STEEL TO SUIT WATERSTOPS AND OPENINGS.
 - PROVIDE SUMP PIT WITH GRATING AND SLOPE FLOOR TO SUIT 10mm/METRE.
 - DRAIN OUTLET TO BE LOCATED AT NEAREST POINT TO EXISTING SEWER. ELEVATION OF SEWER IS HIGHER THAN CHAMBER FLOOR THE DRAIN MAY BE CLAMPED TO THE WALL BY AN APPROVED METHOD, IF NO SEWER IS AVAILABLE DELETE DRAIN TYPE 'A' AND CONSTRUCT DRAIN TYPE 'B' AND INSTALL PIPE WITH STOPPER AS SHOWN ON DWG.
 - DRAIN CONNECTION TO SEWER TO BE MADE BY CONTRACTOR UNLESS OTHERWISE STATED IN THE GENERAL SPECIFICATIONS.
 - LADDERS, GRATINGS AND RAILINGS TO BE ALUMINUM AND OF REMOVABLE TYPE WITH STAINLESS STEEL BOLTS.
 - TOP TWO STEPS AND ANY ADDITIONAL STEPS IN THE CHIMNEY TO BE OF THE REMOVABLE TYPE.
 - CHAMBERS DEEPER THAN 1200mm FROM SURFACE ELEVATION TO TOP OF VALVE OPERATING SPINDLE SHALL HAVE EXTENSION SPINDLE AND GUIDE BRACKET.
 - ALL ALUMINUM SURFACES CONTACTING CONCRETE TO RECEIVE ONE COAT OF BITUMINOUS PAINT.
 - 'X' DEPENDS ON HEIGHT (H) & BARS SHALL BE COUNTED TO ENSURE THAT THE BOTTOM BAR IS LESS THAN 150mm ABOVE THE ROOF CHAMBER.

BENDING SCHEDULE

BAR NO.	Ø	SHAPE	LENGTH	S	B	E	X	SHAPE	D.C.	NO. REQD.
1001	10	900	220	220	220			3	300	7
1002	10	750	120	230	120			3	150	8
1003	10	1840	520	230	520	230		3	200	19
1004	10	1360	380	230	380	230		3	200	12
1005	10	170						AS SHOWN	15	
1006	10	1425						AS SHOWN	4	
1007	10	1460						AS SHOWN	8	
1008	10	2200						AS SHOWN	5	
1009	10	1000						AS SHOWN	3	
1010	10	1400						AS SHOWN	6	
1011	10	614						AS SHOWN	4	
1012	10	1000						AS SHOWN	6	
1013	10	1000						AS SHOWN	3	
1014	10	1000						AS SHOWN	3	
1015	10	1000						AS SHOWN	3	
1016	10	1300	500					AS SHOWN	9	
1017	10	H#430	H#200	430				AS SHOWN	3	
1018	10	H#100	100	500				AS SHOWN	3	
1019	10	H#484	H#100	614				AS SHOWN	3	
1020	10	2440	1940	500				AS SHOWN	7	
1021	10	1300	300	1300	300			AS SHOWN	2	
1022	10	4080	500	3000	500			AS SHOWN	2	
1023	10	3700						AS SHOWN	5	
1024	10	3700						AS SHOWN	28	
1025	10	2700						AS SHOWN	30	
1026	10	1400						AS SHOWN	6	
1027	10	1800						AS SHOWN	22	
1028	10	1460						AS SHOWN	5	
1029	10	2200						AS SHOWN	3	
1030	10	2370	2700	300				AS SHOWN	10	
1031	10	2270	1000	300				AS SHOWN	10	
1032	10	1720	700	500				AS SHOWN	18	
1033	10	1840	1000	1000				AS SHOWN	8	
1034	10	2540	300	3000	800			AS SHOWN	13	
1035	10	2440	1200	2000	1200			AS SHOWN	32	
1036	10	1660						AS SHOWN	6	
1037	10	2270	1940	500				AS SHOWN	2	
1038	10	1810	1400					AS SHOWN	12	
1039	10	2960	2000					AS SHOWN	2	
1040	10	4280	3000					AS SHOWN	3	
1041	30	ØS. OF PIPE x 600						AS SHOWN	8	

FOR REINFORCING AT DRAIN REFER TO SUMP AND DRAIN DETAIL DWG.

MATERIAL LIST

MARK	SUPPLIED BY CITY OF TORONTO	MARK	SUPPLIED BY CONTRACTOR
T2	4-30mm GATE VALVE (DOWNS)	C40	1-900mm FABRICATED S.S. FLG. CONNECTION
T3	1-150mm HW VALVE FLANGE	C41	1-900mm FABRICATED S.S. HWY. 10 HWY. FLANGE EACH WITH 1N1 (L.U.C.)
T4	1-100mm GATE VALVE FLANGED	C42	1-900mm FABRICATED S.S. METALIC CONNECTION
T5	1-150mm BACKWATER CHECK VALVE	C43	2-800mm WCT. COUPLING, STREET4 SHOULDER.
T6	1-150mm BACKWATER CHECK VALVE	C44	1-900mm FABRICATED S.S. FLANGE ASSEMBLY.
T7	CENTRE PLUG FOR CHAMBER COVER	C45	2-1200mm TO 900mm REDUCERS
T8	1-900mm HW BUTTERFLY VALVE	C46	2-1200mm TO 900mm REDUCERS
T9	1-100mm HW BUTTERFLY VALVE	C47	1-CIRCULAR COVER WITH FRAME AS PER METHOD-POLYMER CONCRETE AREA STANDARD DRAWING No. 410 and 411 (WITHOUT CENTRE PLUG)
T10	1-SMALL ROUND TOP	C48	36-H#39 x 165mm L.C. S.S. BOLTS & NUTS
		C49	36-H#39 x 165mm L.C. S.S. CHAINS
		C50	1-CHD ANCHOR WITH 1/2" S.S. BOLTS WITH NUT
		C51	1-CHD ANCHOR WITH 1/2" S.S. BOLTS WITH NUT
		C52	2-900mm CLOTH INSULATED RUBBER GASKETS (FULL FACE, ONE PIECE)
		C53	1-L.C. RUNNING TRAP WITH CLEANOUT & COVER
		C54	1-150mm SOL. PIPING
		C55	1-150mm SOL. PIPING
		C56	1-150mm SOL. PIPING
		C57	1-STEEL PLATE, 300mm x 300mm x 6mm
		C58	1-STEEL PLATE, 300mm x 300mm x 6mm
		C59	2-STANDING BUTTERFLY VALVE SUPPORTS

CHAMBERS

CHAMBER NO.	CHAMBER & ELEV. (m)	MANHOLE & ELEV. (m)	SURFACE IN ELEV. (m)	DIFFERENCE IN ELEV. (m)	COVER LOCATION	DRAIN TYPE	OUTLET DIRECTION	FOR LOCATION REFER TO PLAN NO.	REMARKS

ALL DIMENSIONS SHOWN HERE ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

			GENERAL MANAGER, TORONTO WATER		DIRECTOR, Design and Construction Linear Underground Infrastructure		Title SubTitle1 SubTitle2	
							900 mm HORIZONTAL BUTTERFLY VALVE CHAMBER (POSITION 'A')	
DESIGN	Design	DRAWN	Drawn	CHECKED	Checked	CONTRACT No. X-X		
SCALE	SCALE					DRAWING NUMBER		
DATE	DATE					T-1110.09-1		
No.	DATE	REVISIONS	INITIAL	SIGNED			SHEET X OF X	