


THIS SIDE TYPICAL FOR
WATERPROOF MEMBRANCE
BELOW GRADE INSTALLATION

THIS SIDE TYPICAL FOR
WATERPROOF MEMBRANCE
ABOVE GRADE INSTALLATION

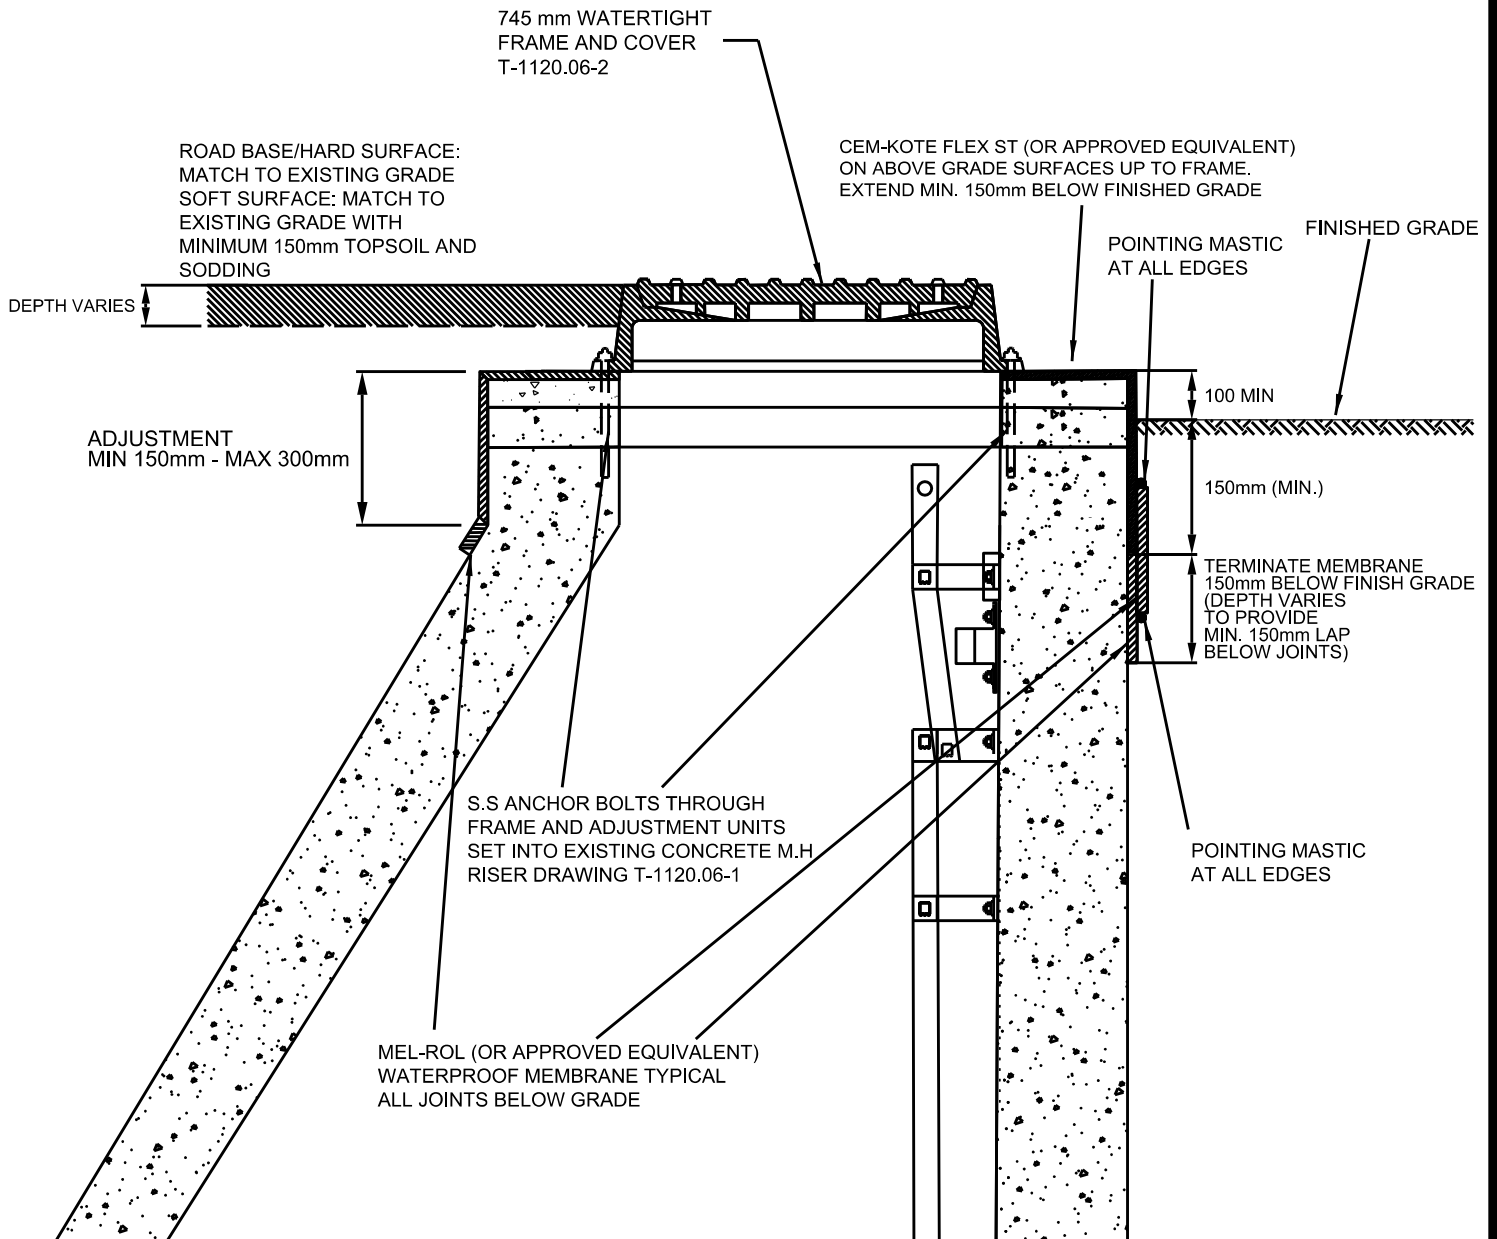

NOTES:

1. FIRST STEP TO BE 75mm TO 450mm BELOW FRAME.
2. WATERPROOF MEMBRANE SHALL BE APPLIED EXTERNALLY AROUND RISER SECTION, GRADE ADJUSTMENT UNITS. WATERPROOF MEMBRANE BELOW GRADE TO BE "MEL-ROL" BY W.R. MEADOWS OF MILTON, ONTARIO OR APPROVED EQUIVALENT. WATERPROOF ABOVE GRADE SURFACES TO BE "CEM-KOTE FLEX ST" BY W.R. MEADOWS OF MILTON, ONTARIO OR APPROVED EQUIVALENT.
3. ALL DIMENSIONS ARE NOMINAL.

All dimensions are in millimetres unless otherwise shown.



ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING

**MAINTENANCE HOLE WATERPROOFING
MEMBRANE**

REV 1

SEP 2021

T-1120.06-3

NTS

SHEET 1