


### POSITIVE DRAINAGE

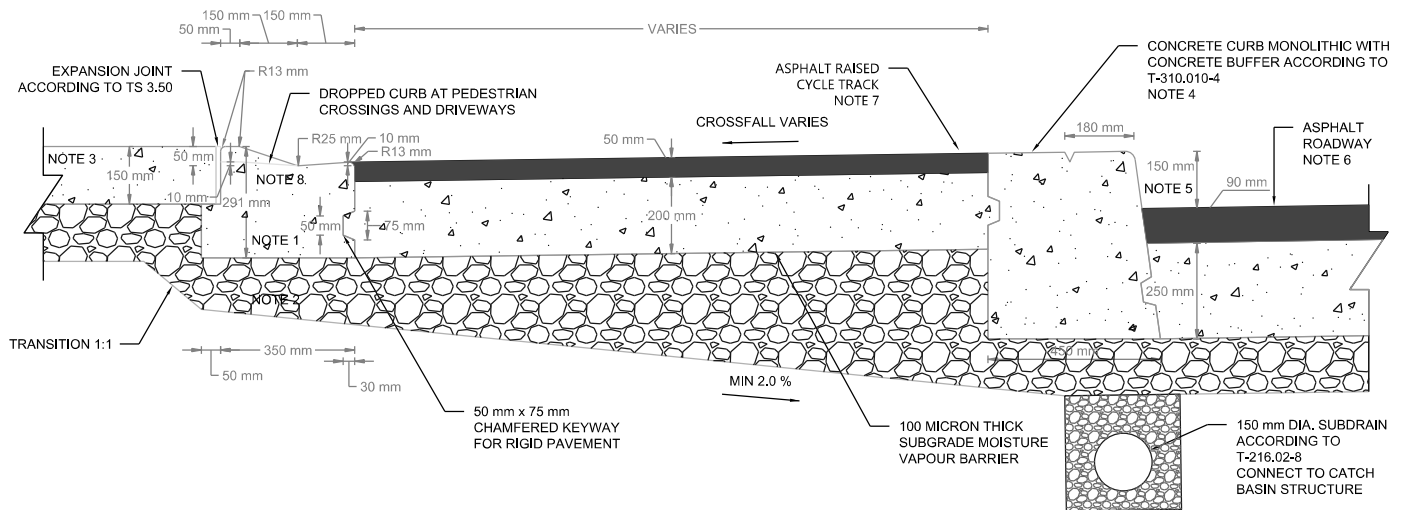

### REVERSE DRAINAGE

**NOTES:**

1. CONTRACTION JOINTS SHALL BE PLACED AT A MAXIMUM OF 4.5 m SPACING AND SHALL BE SAW CUT OR FORMED TO A DEPTH OF 50 mm
2. MINIMUM 150 mm GRANULAR A NATIVE OR GRANULAR A RCM BASE
3. SIDEWALK THICKNESS 150 mm EXCEPT ACROSS COMMERCIAL, INDUSTRIAL, AND HIGH DENSITY RESIDENTIAL DRIVEWAY WHERE THICKNESS SHALL BE 180 mm
4. DRAWING SHOWS T-310.010-4, BUT ALL STANDARD CURBS MAY BE USED
5. CURB HEIGHT AT MINIMUM 100 mm, MAXIMUM 180 mm. 150 mm PREFERRED
6. 90 mm ASPHALT (TYPE AS SPECIFIED OR MATCH EXISTING)
7. 50 mm ASPHALT SP 9.5 B, PG 58-28
8. OPTIONAL DROPPED CURB, GUTTER WIDTH IS OPTIONAL
9. ALL CONCRETE SURFACES SHALL BE TACK COATED WITH SS-1 OR SS-1HH PRIOR TO PLACING ASPHALT

ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING

REV 0

SEP 2022



## INTERMEDIATE HEIGHT RAISED CYCLE TRACK WITH BEVELED SEPARATION CURB

T-990.300

NTS

SHEET 1