
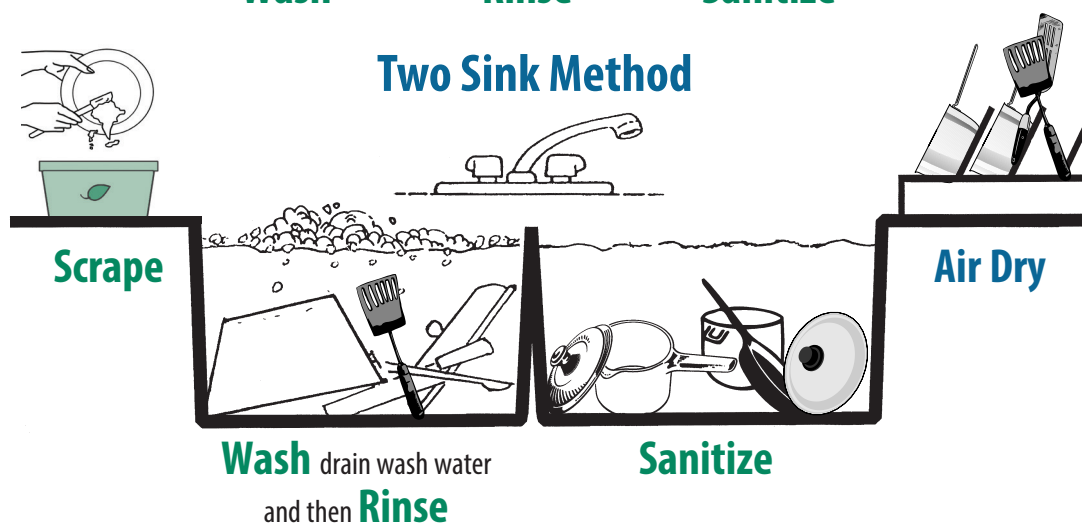


Steps to a PASS

Cleaning and Sanitizing Utensils

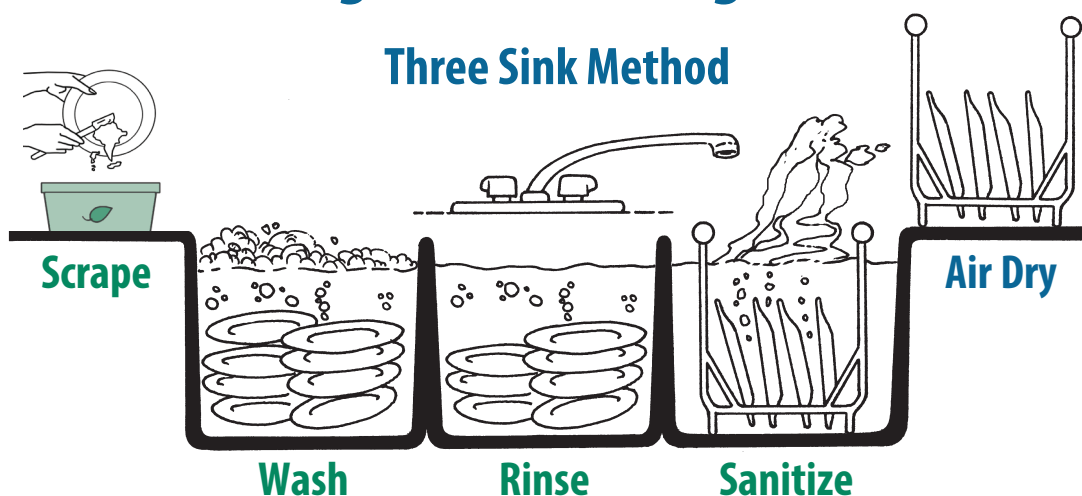

Wash in warm water at a minimum 24°C (75°F) and detergent

Rinse in clean warm water at a minimum 43°C (110°F)

Sanitize for at least 45 seconds in one of the following solutions:

- Hot water at 77°C
- Chlorine at 100 ppm
- Quaternary ammonium at 200 ppm
- Iodine at 25 ppm
- Any other sanitizer approved by Health Canada, Canadian Food Inspection Agency or medical officer of health and used in accordance with the manufacturer's instructions

Note: • Do not mix bleach & detergent • Use a test reagent to check sanitizer concentration • Use an accurate thermometer to check water temperature