


FOR USE WITH RIGID PAVEMENT

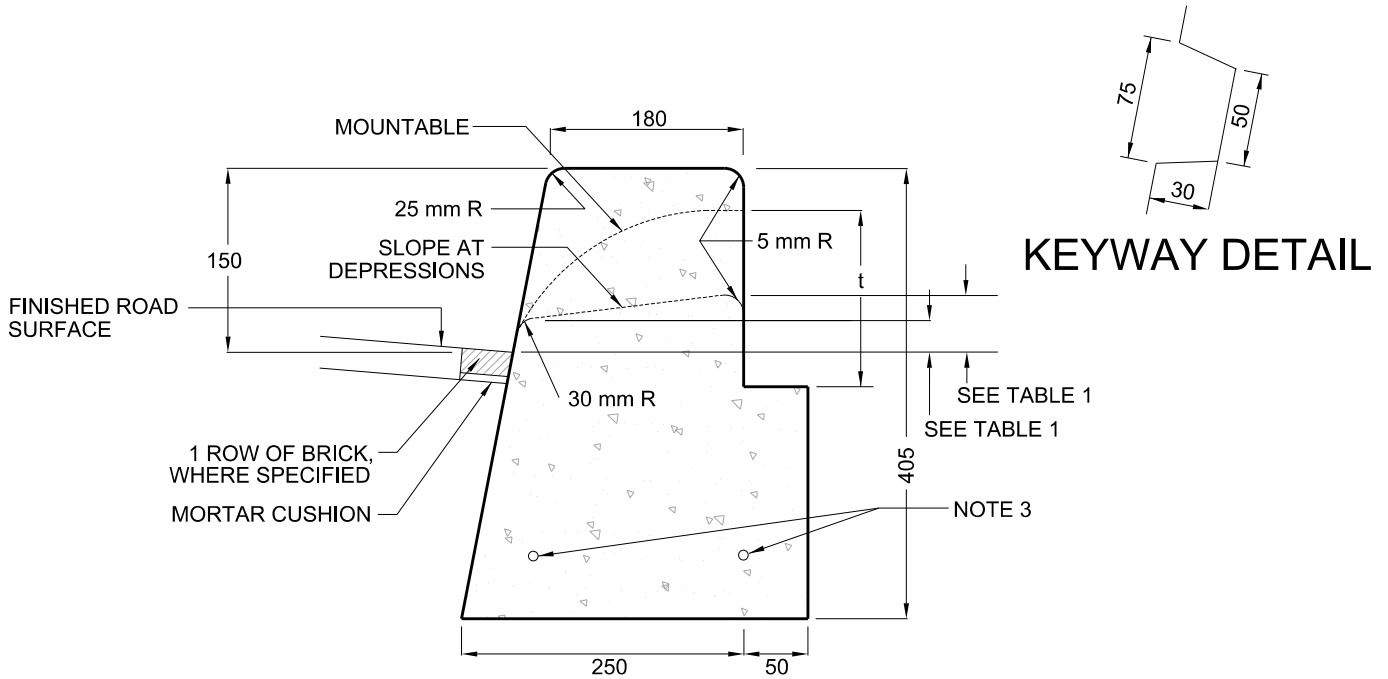

FOR USE WITH FLEXIBLE PAVEMENT

NOTES:

1. EXPANSION JOINTS SHALL BE SPACED 6 m APART OR COINCIDE WITH JOINTS IN ADJACENT SIDEWALK AND CONCRETE ROAD BASE.
2. $t = 130$ mm, 150 mm, OR 180 mm TO SUIT CONCRETE SIDEWALK, CONCRETE BOULEVARD OR CONCRETE DRIVEWAY MEASURED FROM TOP OF CURB DEPRESSION.
3. 2 - 15 M REINFORCING BARS FOR INDUSTRIAL AND COMMERCIAL DRIVEWAYS, 50 mm CONCRETE COVER, TO BE EXTENDED 600 mm BEYOND WIDTH OF DRIVEWAY ON EACH END.
4. ENTRANCE TERMINATION ACCORDING TO DRAWING T-350.01.

LOCATION	CURB HEIGHT	
	FACE OF CURB	BACK OF CURB
DROP CURB FOR PEDESTRIAN CROSSING	10 mm	30 mm
DROP CURB AT ENTRANCE	30 mm	50-80 mm (NOTE 4)

TABLE 1

All dimensions are in millimetres unless otherwise shown.



ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING

REV 3

SEP 2024

CONCRETE CURB

T-600.11-1

NTS

SHEET 1