




Notes:

1. Groundwater flow measuring equipment and sampling port according to T-709.020, T-709.030 and T-709.010.
2. Groundwater sump pumps(s) shall be in duty/standby configuration.
3. Emergency foundation drainage infrastructure components to be installed with construction of proposed building or at time of emergency. Temporary connection to be installed and caps removed at time of emergency discharge.
4. For details of emergency foundation drainage infrastructure profile, see T-709.051.

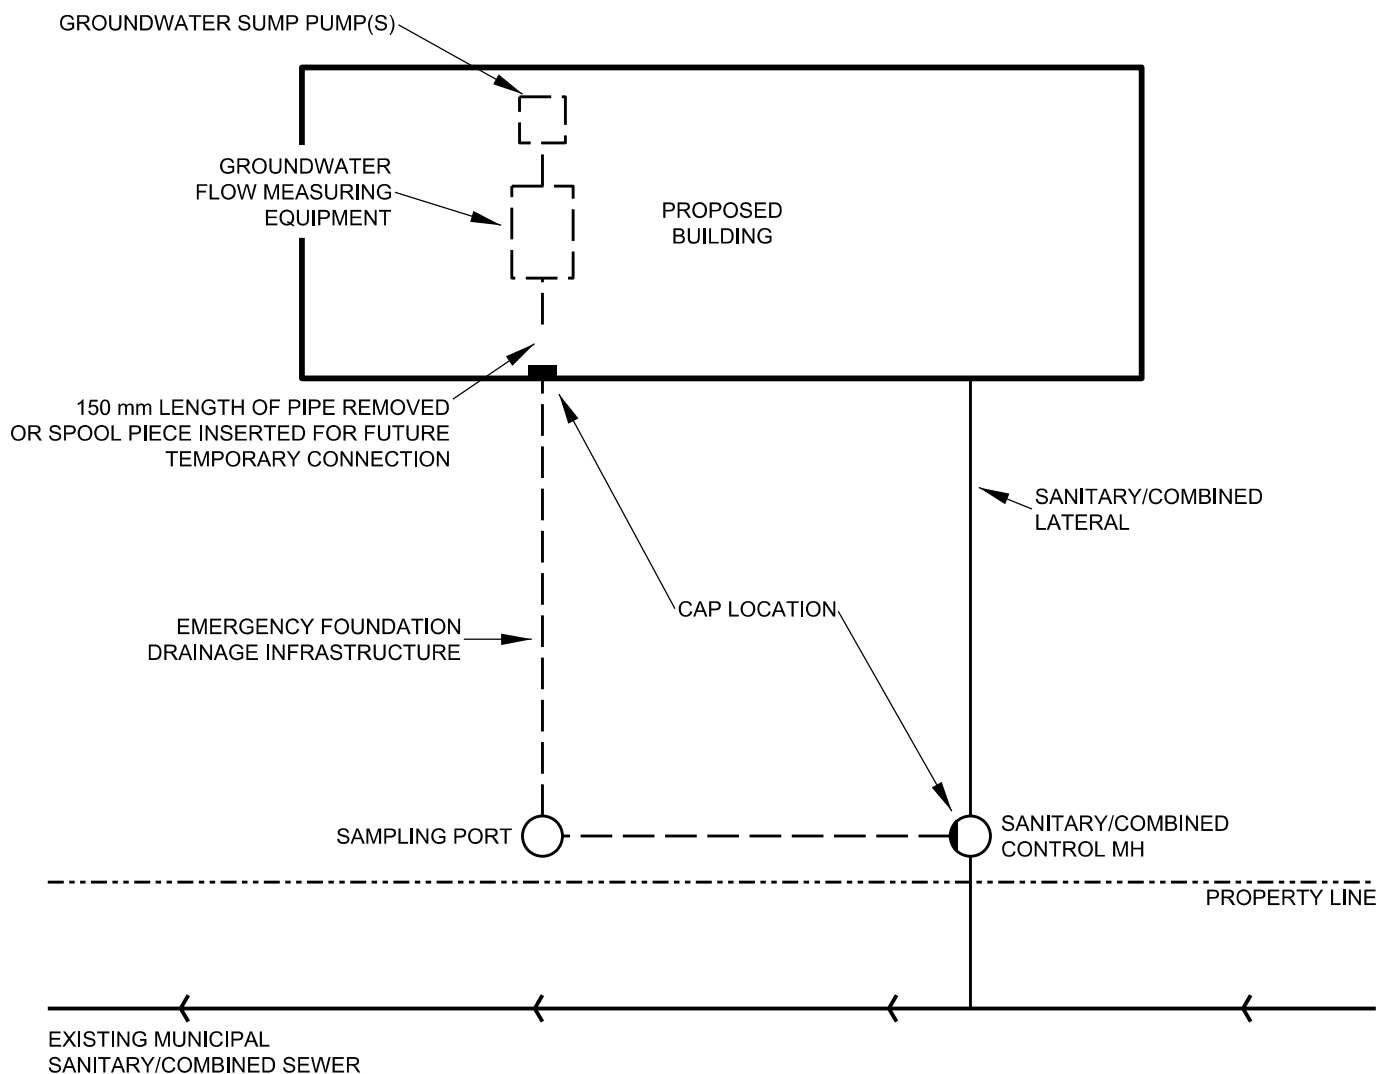

ENGINEERING & CONSTRUCTION SERVICES STANDARD DRAWING

REV 0

SEPT 2026

**EMERGENCY FOUNDATION
DRAINAGE INFRASTRUCTURE
LAYOUT**

T-709.050

NTS

SHEET 1