


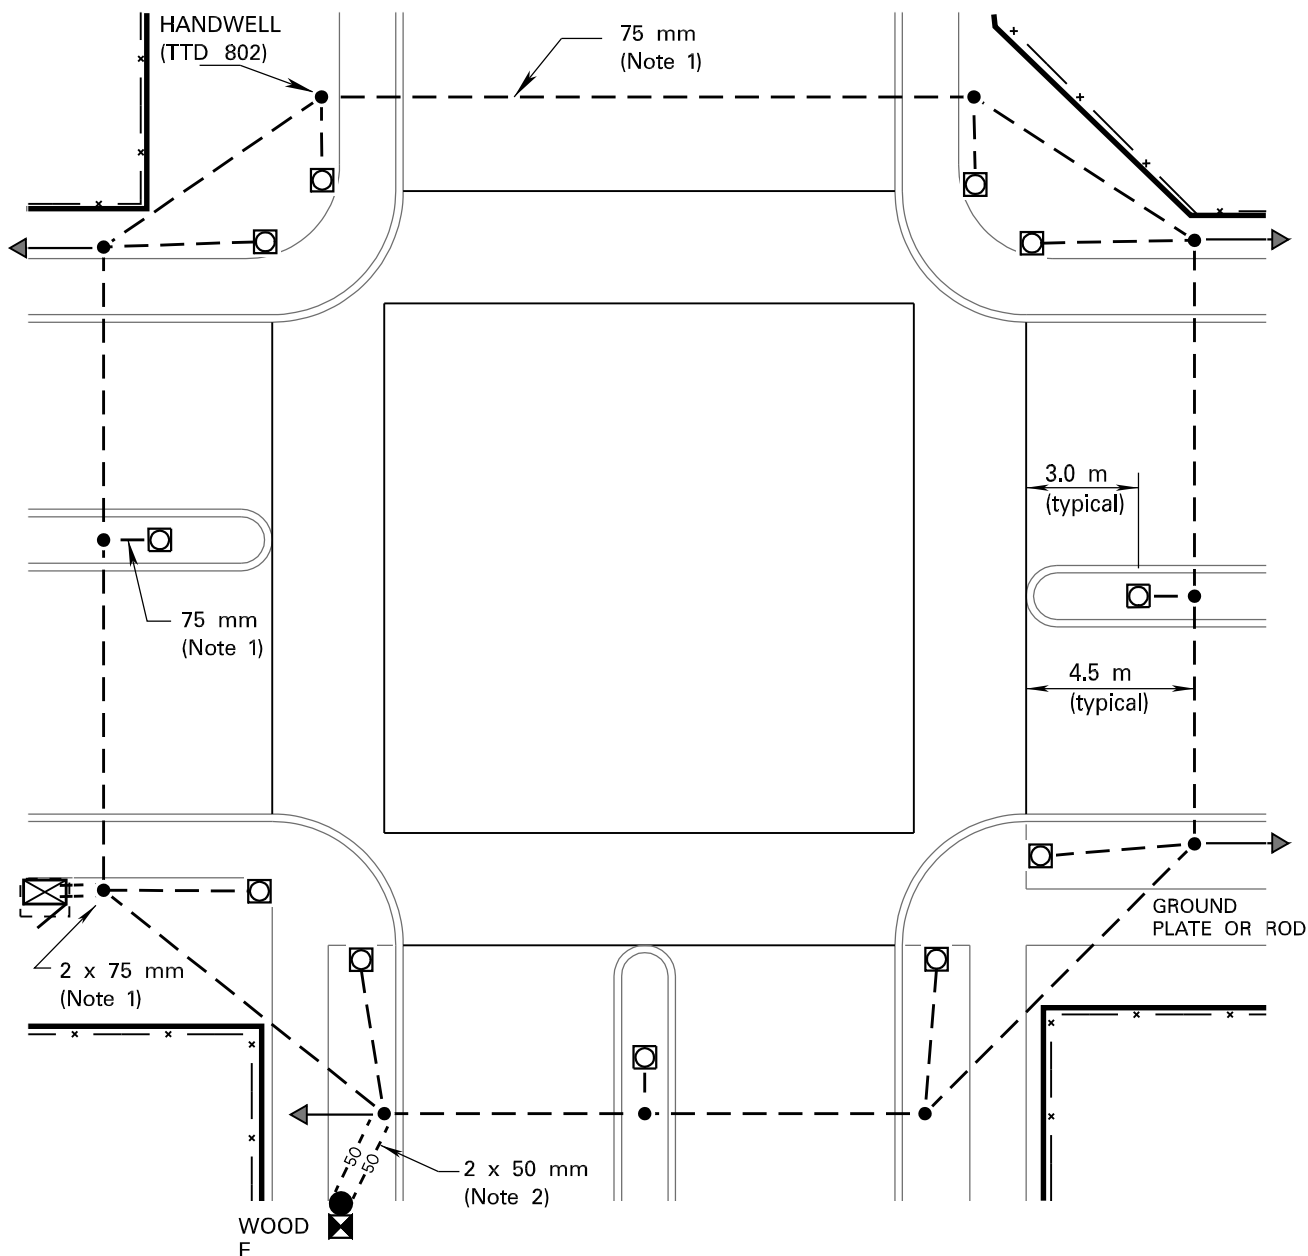

NOTES

1. PRIMARY DUCTS TO BE AT LEAST 75 mm RIGID P.V.C. SCEPTER OR APPROVED EQUAL OR 75 mm HEAVY WALL DUCT WITH DIRECTIONAL BORING.
2. SECONDARY DUCTS TO BE 50 mm RIGID P.V.C. TO UTILITY POLES
3. FOR LOOP FEEDER DUCT, SEE FIGURE 6